


Diagram 5
Storage Tank Boilover
Impact Areas

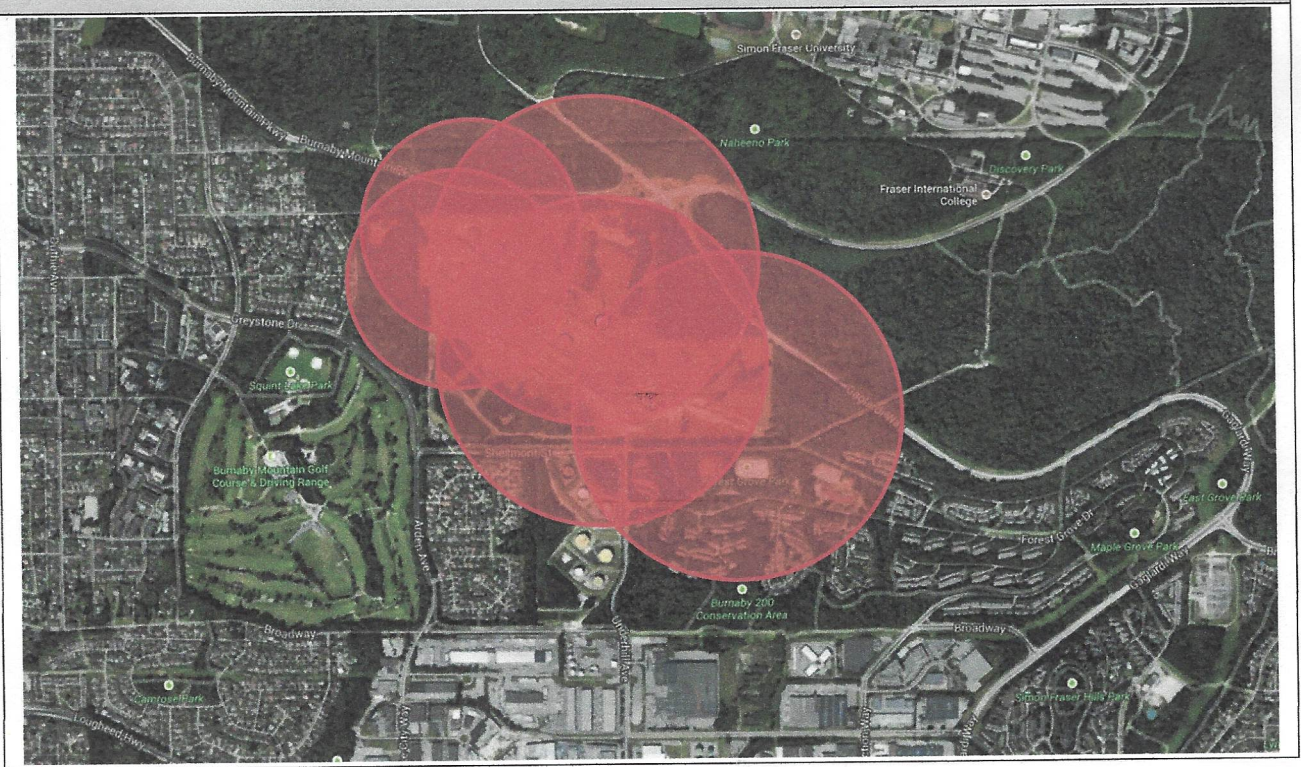

The scope of the area potential impacted by a Boilover scenario is illustrated in Diagram 5. It is anticipated that the consequences of Boilover exposure within the areas identified would include:

- Human Injuries to Emergency Responders and unevaluated civilians
- Mass Tree Top Based Wildland Fire initiation
- Structural Fire initiation to many residential buildings
- Potential Tank Fire initiation within the TMTF and the Shellmont Tank Farm
- Significant isolation of the SFU and UniverCity communities